




Devices

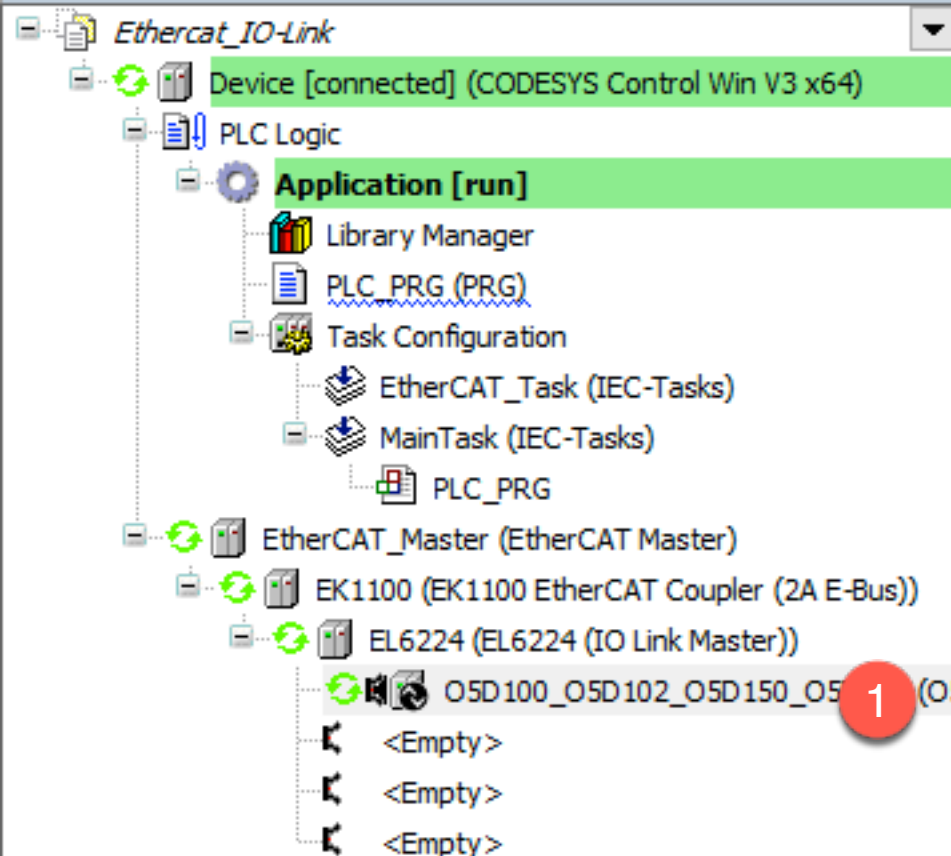

PLC_PRG

EtherCAT_Master

EK1100

Device

<Empty>

O5D100_O5D102_O5D150_O5D152 x

IO-Link Device Info

IO-Link Parameter **2**

IO-Link I/O Mapping

EL6224 Settings

Information

Status



User role: Maintenance

☐ Identification menu☒ Parameter menu☐ Diagnosis menu☐ Observation menu

Set to defaults

 Read this page **4** Write this page **5**

Name	Value	Unit	r/w	Description
+ Switchpoint configuration				
+ Process data limit values				
- Setup				
- Data Storage Lock	false		rw	
- Local Parameterization Lock	false		rw	
- Laser 3	Laser off		rw	Laser configuration
- Display	Display on		rw	Display configuration
- Keylock	Unlocked		rw	
- Standard Command	Restore Factory Set...		wo	